



OVERHEAD PERMANENT SERVICE
METER BASE ON HOUSE

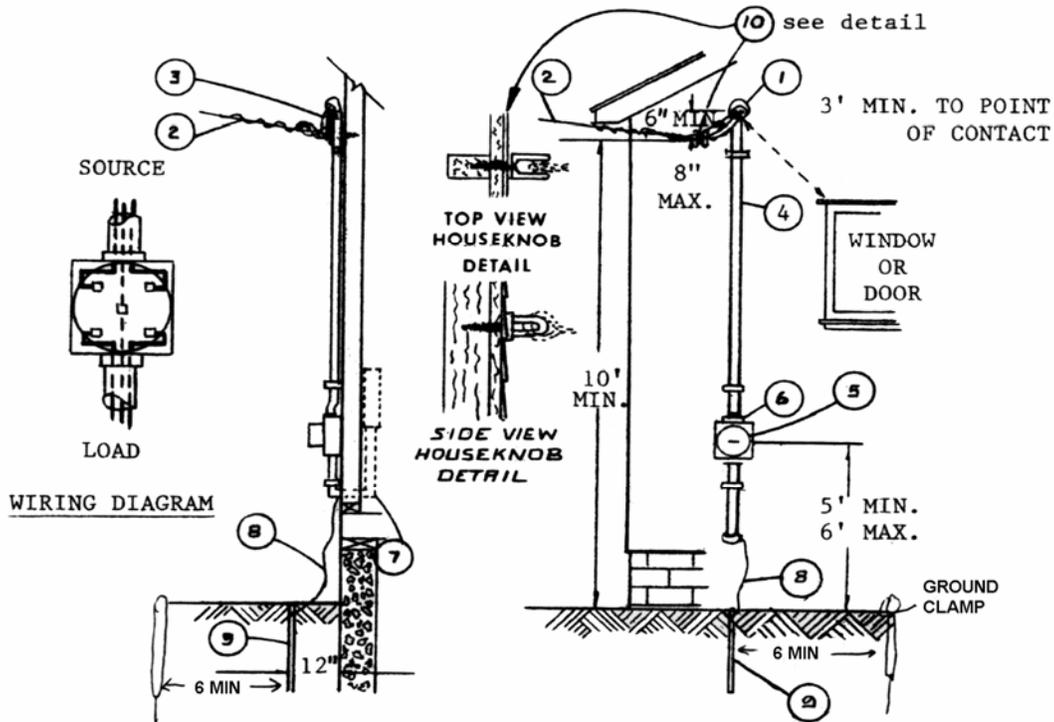

METER BASE ON POLE

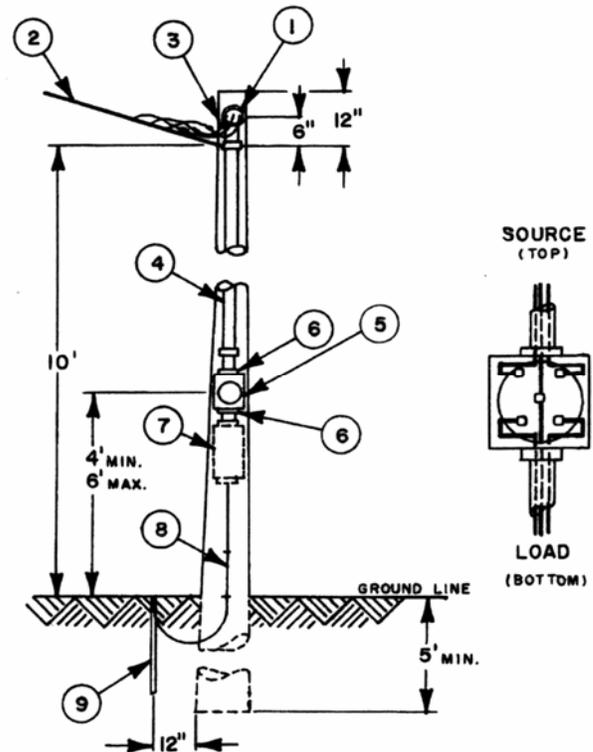

1. Weather head.
2. Company's service drop 10 ft. minimum ground clearance at point of attachment.
3. Minimum two (2) feet of service entrance wire required for connection to service drop.
4. N.E.C. approved service entrance cable or single conductors in electrical grade conduit.
5. Meter base furnished by Electric Company, installed by the customer. The use of rear knockouts is not allowed.
6. Watertight connection.
7. Customer's service entrance equipment, as required per N.E.C.
8. Minimum #6 bare copper ground electrode conductor.
9. N.E.C. approved ground rod clamp and two (2) eight (8) foot minimum ground rod installed below grade.
10. Service assembly — installed by customer, must be securely anchored in stud.

SPECIAL NOTES:

- a. Electrical permit, inspection and approval are required before service is energized. Please contact Antrim County Electrical Inspector for code requirements.
- b. All service wiring and equipment including 16 ft. minimum treated pole/post shall be furnished and installed by the customer.
- c. Electrical Companies reserve the right to refuse to connect any service that, in their opinion, is unsafe to climb or will not safely support a man on a ladder.