



UNDERGROUND SERVICE TEMPORARY SERVICE

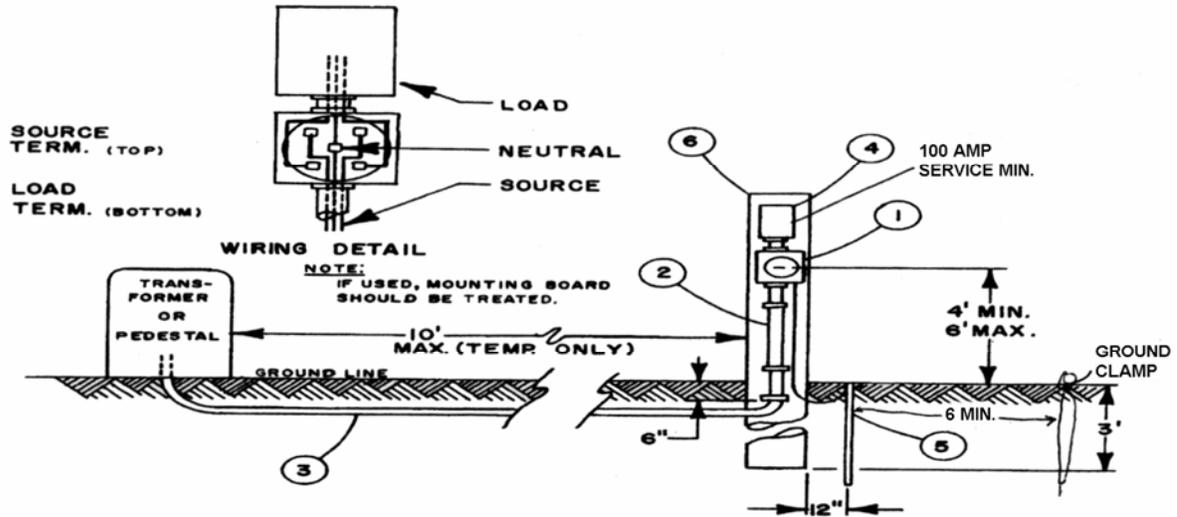

1. Meter base, furnished by local Electric Company, installed by customer.
2. Minimum two (2) inch conduit, including insulation bushing, furnished and installed by customer.
3. Company service conductors, furnished, installed, owned and maintained by Electric Company.
4. N.E.C. approved service entrance cable or single conductors in electrical grade conduit. The use of the rear knockouts in the meter is not permitted. Furnished and installed by customer.
5. N.E.C. approved ground rod clamp, and two (2) eight (8) foot minimum ground rod installed below grade.
6. Treated post/pedestal furnished and installed by customer.

METER BASE ON POST

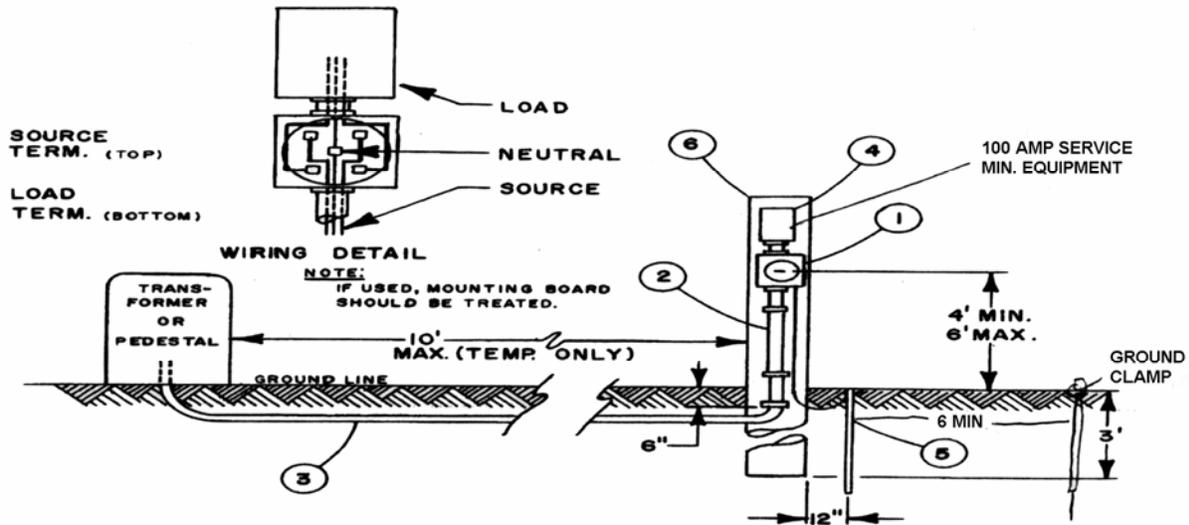

SPECIAL NOTES:

- ❖ Electrical permit, inspection and approvals are required before service is energized.
- ❖ The use of a meter base designed and intended for overhead service is not allowed and will not be connected.

TEMPORARY SERVICE ONLY (PER THE ELECTRIC COMPANY):

The services for temporary use only, and are intended to provide service for construction purposes. The service is allowed to continue for six months from the time of installation. An extension of this time, beyond the six-month period, will be allowed only by written permission. Under no circumstances will services be allowed to continue beyond 12 months. The 10-ft. maximum-service length will be strictly enforced.

*Information provided by Great Lake Energy.

March 17, 2005